

**WATER MANAGEMENT DEPARTMENT**

**Mark S. Hilty,**  
Director



**Dr. Ken Moore**  
Mayor

**Eric S. Stuckey**  
City Administrator

---

HISTORIC  
**FRANKLIN**  
TENNESSEE

July 13, 2016

Ms. Ann Rochelle  
Tennessee Department of Environment and Conservation  
711 R.S. Gass Boulevard  
Nashville, TN 37243

RE: Overflow Report – 401 Alicia Drive  
NPDES Permit# TN0028827

On July 9<sup>th</sup>, at 12:50pm we received a call pertaining to an overflow at 401 Alicia Drive. Crews were dispatched to the location and arrived on site at 1:40pm. Upon arrival crews noticed wastewater seeping out of a manhole in front of the address. Crews noted the overflow was occurring at a rate of approximately three gallons per minute.

Crews documented the overflow with photographs and began using the Jet Vac Truck to remove the blockage. Crews noted the overflow ceased at 1:55pm. The overflow was caused by grease. After the flow returned to normal, crews cleaned that section of main again, and used the Jet Vac Truck to clean the affected area. Crews investigated the area and determined the overflow was contained to the ground surface. The estimated volume of the overflow was 195 gallons. All corrective actions were complete at 2:45pm.

On July 11<sup>th</sup>, CCTV crews were dispatched to the location to inspect the upstream and downstream lines and noted all lines were in proper operating condition.

I have attached a map of the area.

If you have any question or comments please let me know. I can be reached at (615) 794 – 4554 or at [jrlee@franklintn.gov](mailto:jrlee@franklintn.gov).

Sincerely,


A handwritten signature in black ink, appearing to read 'JR Lee'.

JR Lee  
Assistant Wastewater Collection Superintendent


401 Alicia Dr

Point of Overflow


Point of Blockage




Standard




Collectors



Interceptors




Wetted Area



Parcels



1 in = 100 ft

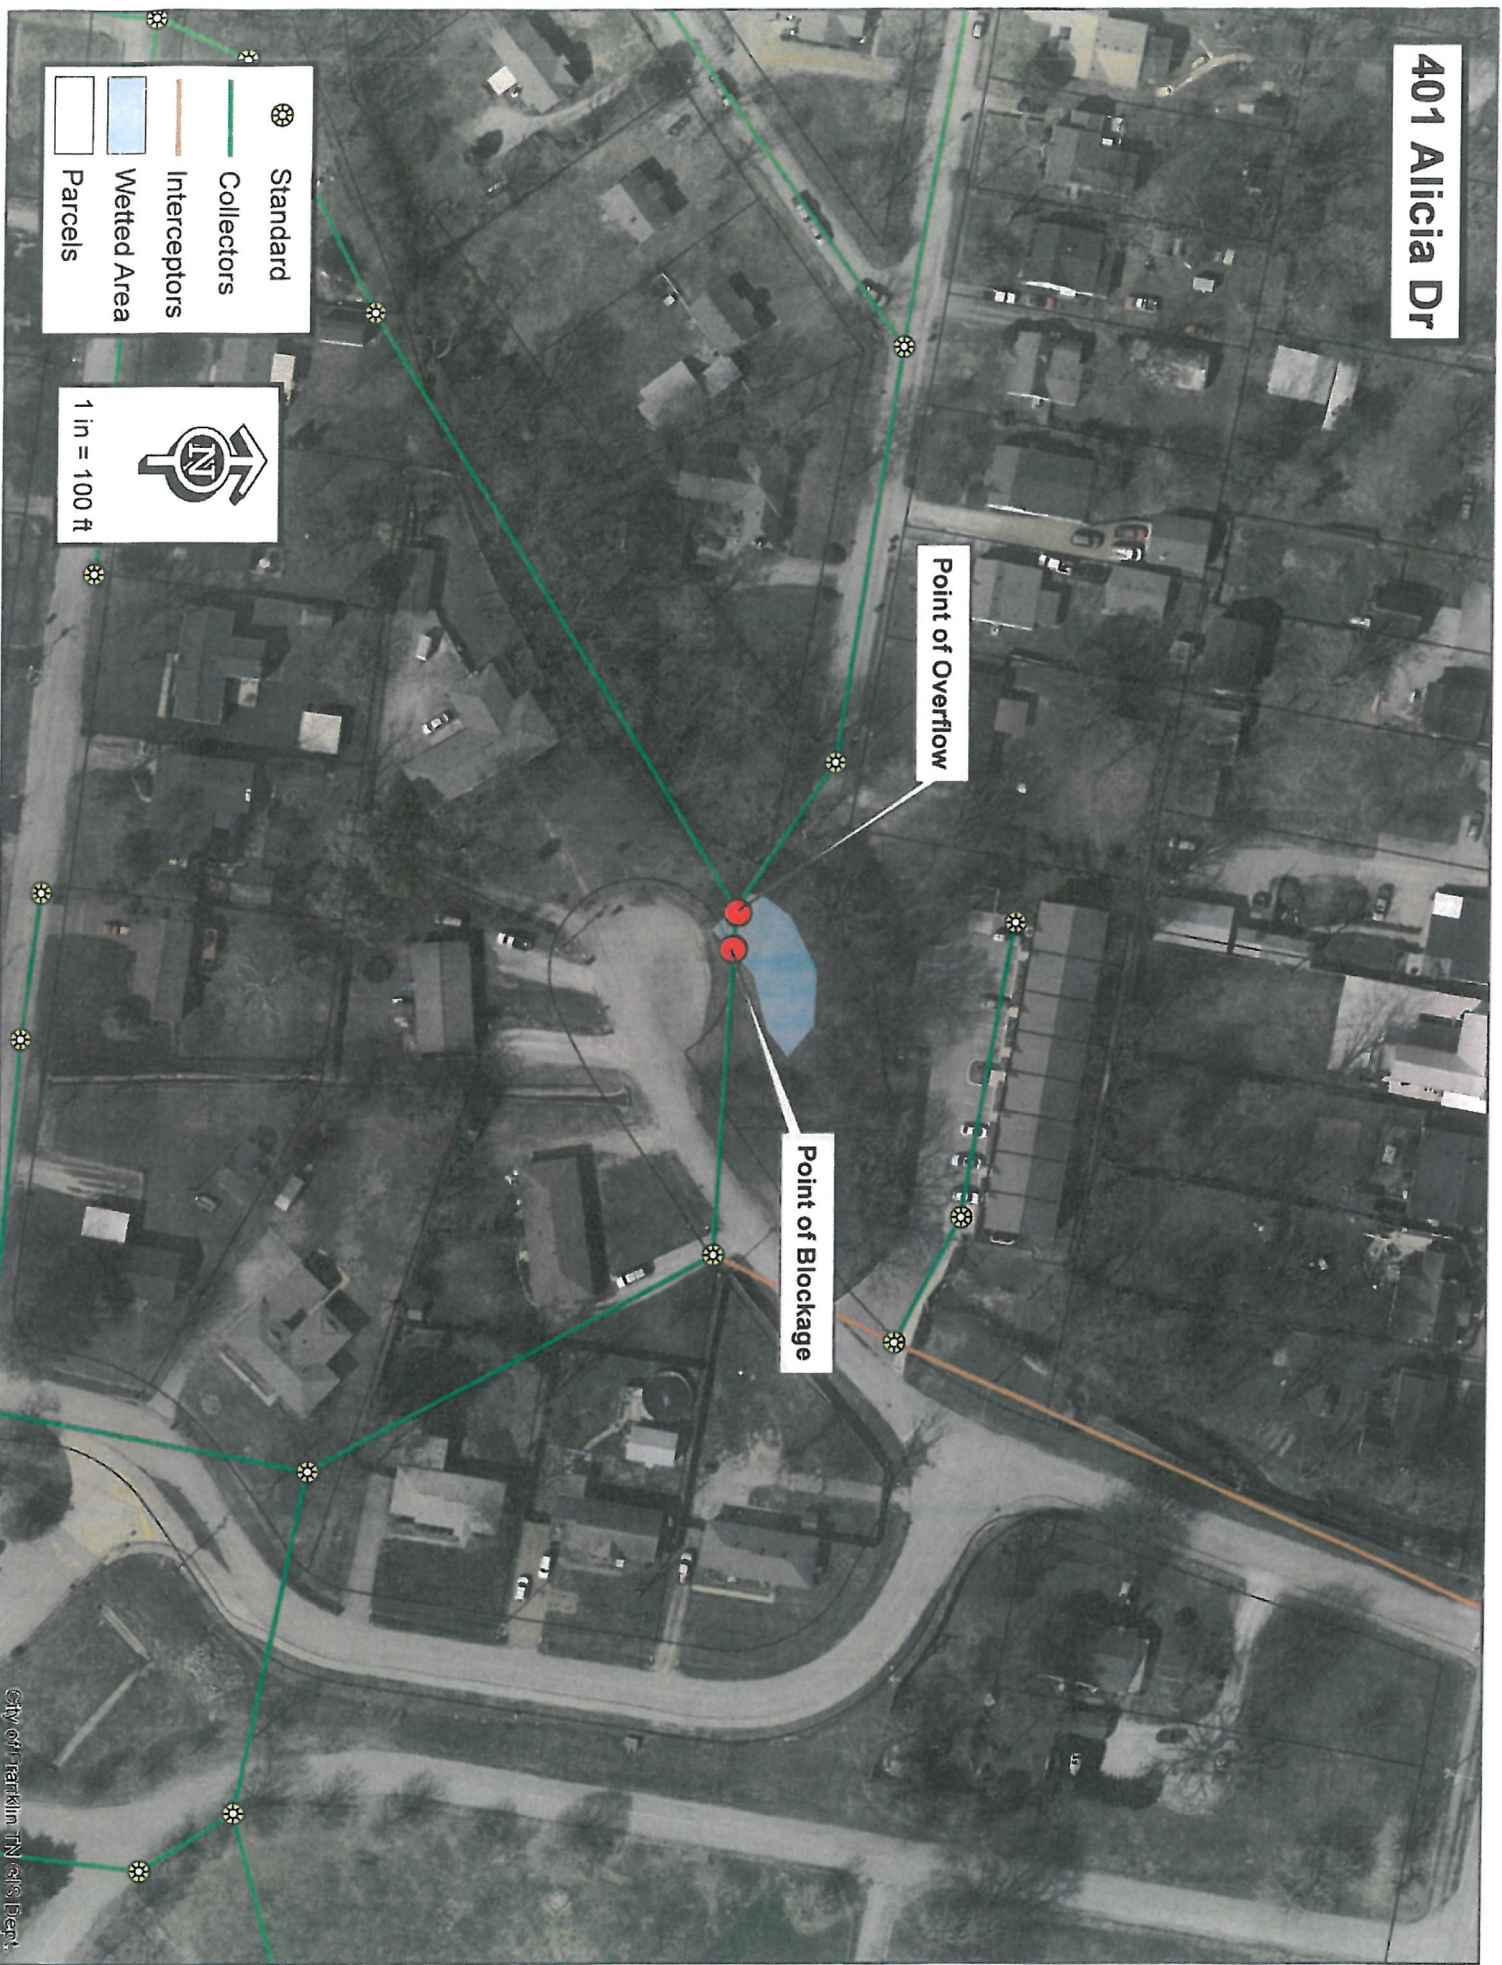





HISTORIC  
FRANKLIN  
TENNESSEE

## Service Request

### REQUEST INFORMATION

Service Request #: 272248

Request Date: 07/11/2016

Priority: 1

Request Type: SSO Public

Assigned To: 2026

Responsible Dept: WATER MANAGEMENT

Source: PHONE

Caller Comments: PUBLIC OVERFLOW

Additional Comments or Information:

### CONTACT INFORMATION

Name: -

Day Phone #:

Cell Phone #:

Email:

Evening Phone #:

Contact Requested: N

### LOCATION INFORMATION

Service Address:

Subdivision:

COF Water Service Area:

City Limits:

Location Details: 401 ALICIA DR

### RESOURCE USAGE

Employee Name / #	Date	Start Time	End Time	Total Hours
2038	7-9-16	1:40 PM	2:45 PM	1hr 5m.
2016-4003	7-11-16	8:00 AM	10:30 PM	1HR 30 MIN

Off Truck #	Out of SR	Part Name	Part Number	Quantity Used

Vehicle	Usage
102	1hr 5m.
36	2H 30 MIN

Work Comments
Blockage in sewer main water seeping out of MH beside residence got call at 12:50. Arrived on site at 1:40 start unstop at 1:48 main unstoped & flowing at 1:55. no over flow confined to ground surface 1 CCTV INSPECTION SHOWED ALL LINES OK

For additional comments, please use back.

JR Lee

---

**From:** JR Lee  
**Sent:** Saturday, July 09, 2016 2:31 PM  
**To:** Ann Rochelle (Ann.Rochelle@tn.gov)  
**Cc:** Michelle Hatcher  
**Subject:** Overflow

Ms. Rochelle,

The City of Franklin Water Management Department had an overflow today on Alicia Drive. The overflow was contained to the ground surface. I will sent you a report next week after we finish our investigation to determine the cause.

If you have any questions or concerns you may reach me via email or my cell phone at (615) 512-9472.

Sincerely,

JR Lee  
Assistant Wastewater Collection Superintendent  
City of Franklin Public Works  
Water Management Division  
124 Lumber Dr  
Franklin, TN 37064  
(615) 794-4554  
[Jr.lee@franklintn.gov](mailto:Jr.lee@franklintn.gov)

This message has been prepared on resources owned by the City of Franklin, TN. It is subject to the City's Policy for the Use of Computers, Internet and eMail. Messages that are received or created by any City staff member may be a public record subject to Tennessee Open Records Act, T.C.A. 10-7-503, et seq., and the rules of the Open Records Commission. **DO NOT COPY OR FORWARD TO UNAUTHORIZED PERSONS.** This message may contain confidential information and is intended only for the use of the specific individual(s) to which it is addressed. If you are not an intended recipient of this message, you are hereby notified that any unauthorized use, dissemination or copying of this message or any information it contains is strictly prohibited. If you have received this message in error, please delete it and immediately notify the sender by reply email.

JR Lee

---

**To:** Ann Rochelle (Ann.Rochelle@tn.gov)  
**Cc:** Juan Davis (juand@franklintn.gov); Melinda White; Michelle Hatcher  
**Subject:** Sanitary Sewer Overflow  
**Attachments:** SKMBT\_C45216071309590.pdf

Ms. Rochelle,

See attached overflow report for 401 Alicia Drive. If you have any questions or concerns you may reach me via email or the office.

Sincerely,

JR Lee  
Assistant Wastewater Collection Superintendent  
City of Franklin Public Works  
Water Management Division  
124 Lumber Dr  
Franklin, TN 37064  
(615) 794-4554  
[Jr.lee@franklintn.gov](mailto:Jr.lee@franklintn.gov)

This message has been prepared on resources owned by the City of Franklin, TN. It is subject to the City's Policy for the Use of Computers, Internet and eMail. Messages that are received or created by any City staff member may be a public record subject to Tennessee Open Records Act, T.C.A. 10-7-503, et seq., and the rules of the Open Records Commission. **DO NOT COPY OR FORWARD TO UNAUTHORIZED PERSONS.** This message may contain confidential information and is intended only for the use of the specific individual(s) to which it is addressed. If you are not an intended recipient of this message, you are hereby notified that any unauthorized use, dissemination or copying of this message or any information it contains is strictly prohibited. If you have received this message in error, please delete it and immediately notify the sender by reply email.